

**CITY OF HURSTBOURNE ORDINANCE
CHAPTER 91 – STREETS AND SIDEWALKS**

91.02 - STANDARDS FOR STREET WORK

HURSTBOURNE MIX


91.02 (2) Concrete construction. Concrete shall be “ready mixed” and must be the **“Hurstbourne City Mix”** which is #899 at Ernst Concrete, or approved equivalent, conforming to ASTM Specifications C-94. Air entraining admixture for concrete shall conform to ASTM Specifications C-260-77.

91.03 - STREET CURB CONSTRUCTION AND DESIGN STANDARDS

DRIVEWAY SPECIFICATIONS

Any driveway repair or resurfacing that involves any change of any kind to the street curb must comply with the **construction and design standards** contained in the City of Hurstbourne Driveway Detail.


(SEE PDF – “DRIVEWAY SPECS”) – For exact specifications.

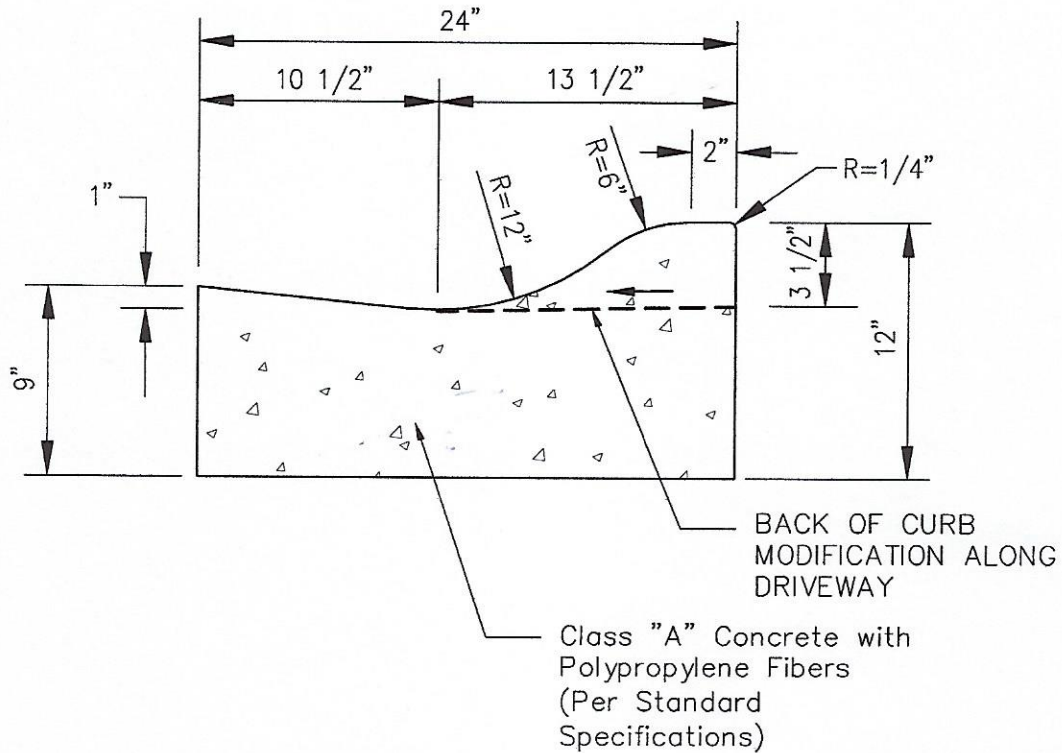

DETAIL

ROLL CURB & GUTTER

SCALE: N.T.S.

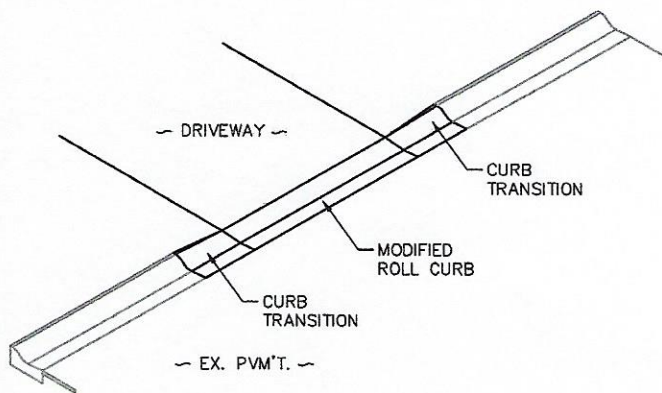

ISOMETRIC VIEW

ROLL CURB & GUTTER

NOTES:

1. CONCRETE SHALL BE 3500 PSI (28 DAY), HURSTBOURNE "HISTORIC MIX #899" (CALL ALLIED READY MIX)
2. PROVIDE "FORTA FERRO" FIBER REINFORCEMENT AT A RATE OF 4 LBS. PER CUBIC YARD OF CONCRETE.
3. PROVIDE 1" DEEP, TOOLED CONTROL JOINTS AT 5' ON CENTER IN CURB.
4. PROVIDE 1/4" EXPANSION JOINT CONTINUOUS WHERE CURB ABUTS EXISTING OR PROPOSED CONCRETE OR STORM STRUCTURES.
5. DGA SHOULD BE COMPACTED A MINIMUM OF 98 PERCENT OF THE MAXIMUM STANDARD PROCTOR DRY DENSITY AS PER ASTM D-698 OR A MINIMUM OF 85 PERCENT RELATIVE DENSITY AS PER ASTM D4253 AND D4254.
6. TAPER ROLL CURB DOWN FROM DRIVEWAY WHILE MAINTAINING FLOWLINE OF GUTTER



3703 Taylorsville Road, Suite 205
Louisville, Kentucky 402220

Phone:
(502) 292-9288

PROJECT NO:

DATE:
JAN. 2013

SCALE:
N.T.S.

DRAWN BY:
CJS

Project

CITY OF HURSTBOURNE
Driveway Details

City of Hurstbourne Kentucky
304 Whittington Parkway
Louisville, Kentucky 40222

Sheet

1